


DETECTABLE UTILITY MARKING TAPE, TYPICAL ALL UTILITIES. 8" TO 10" DEEP. (TYPICAL)

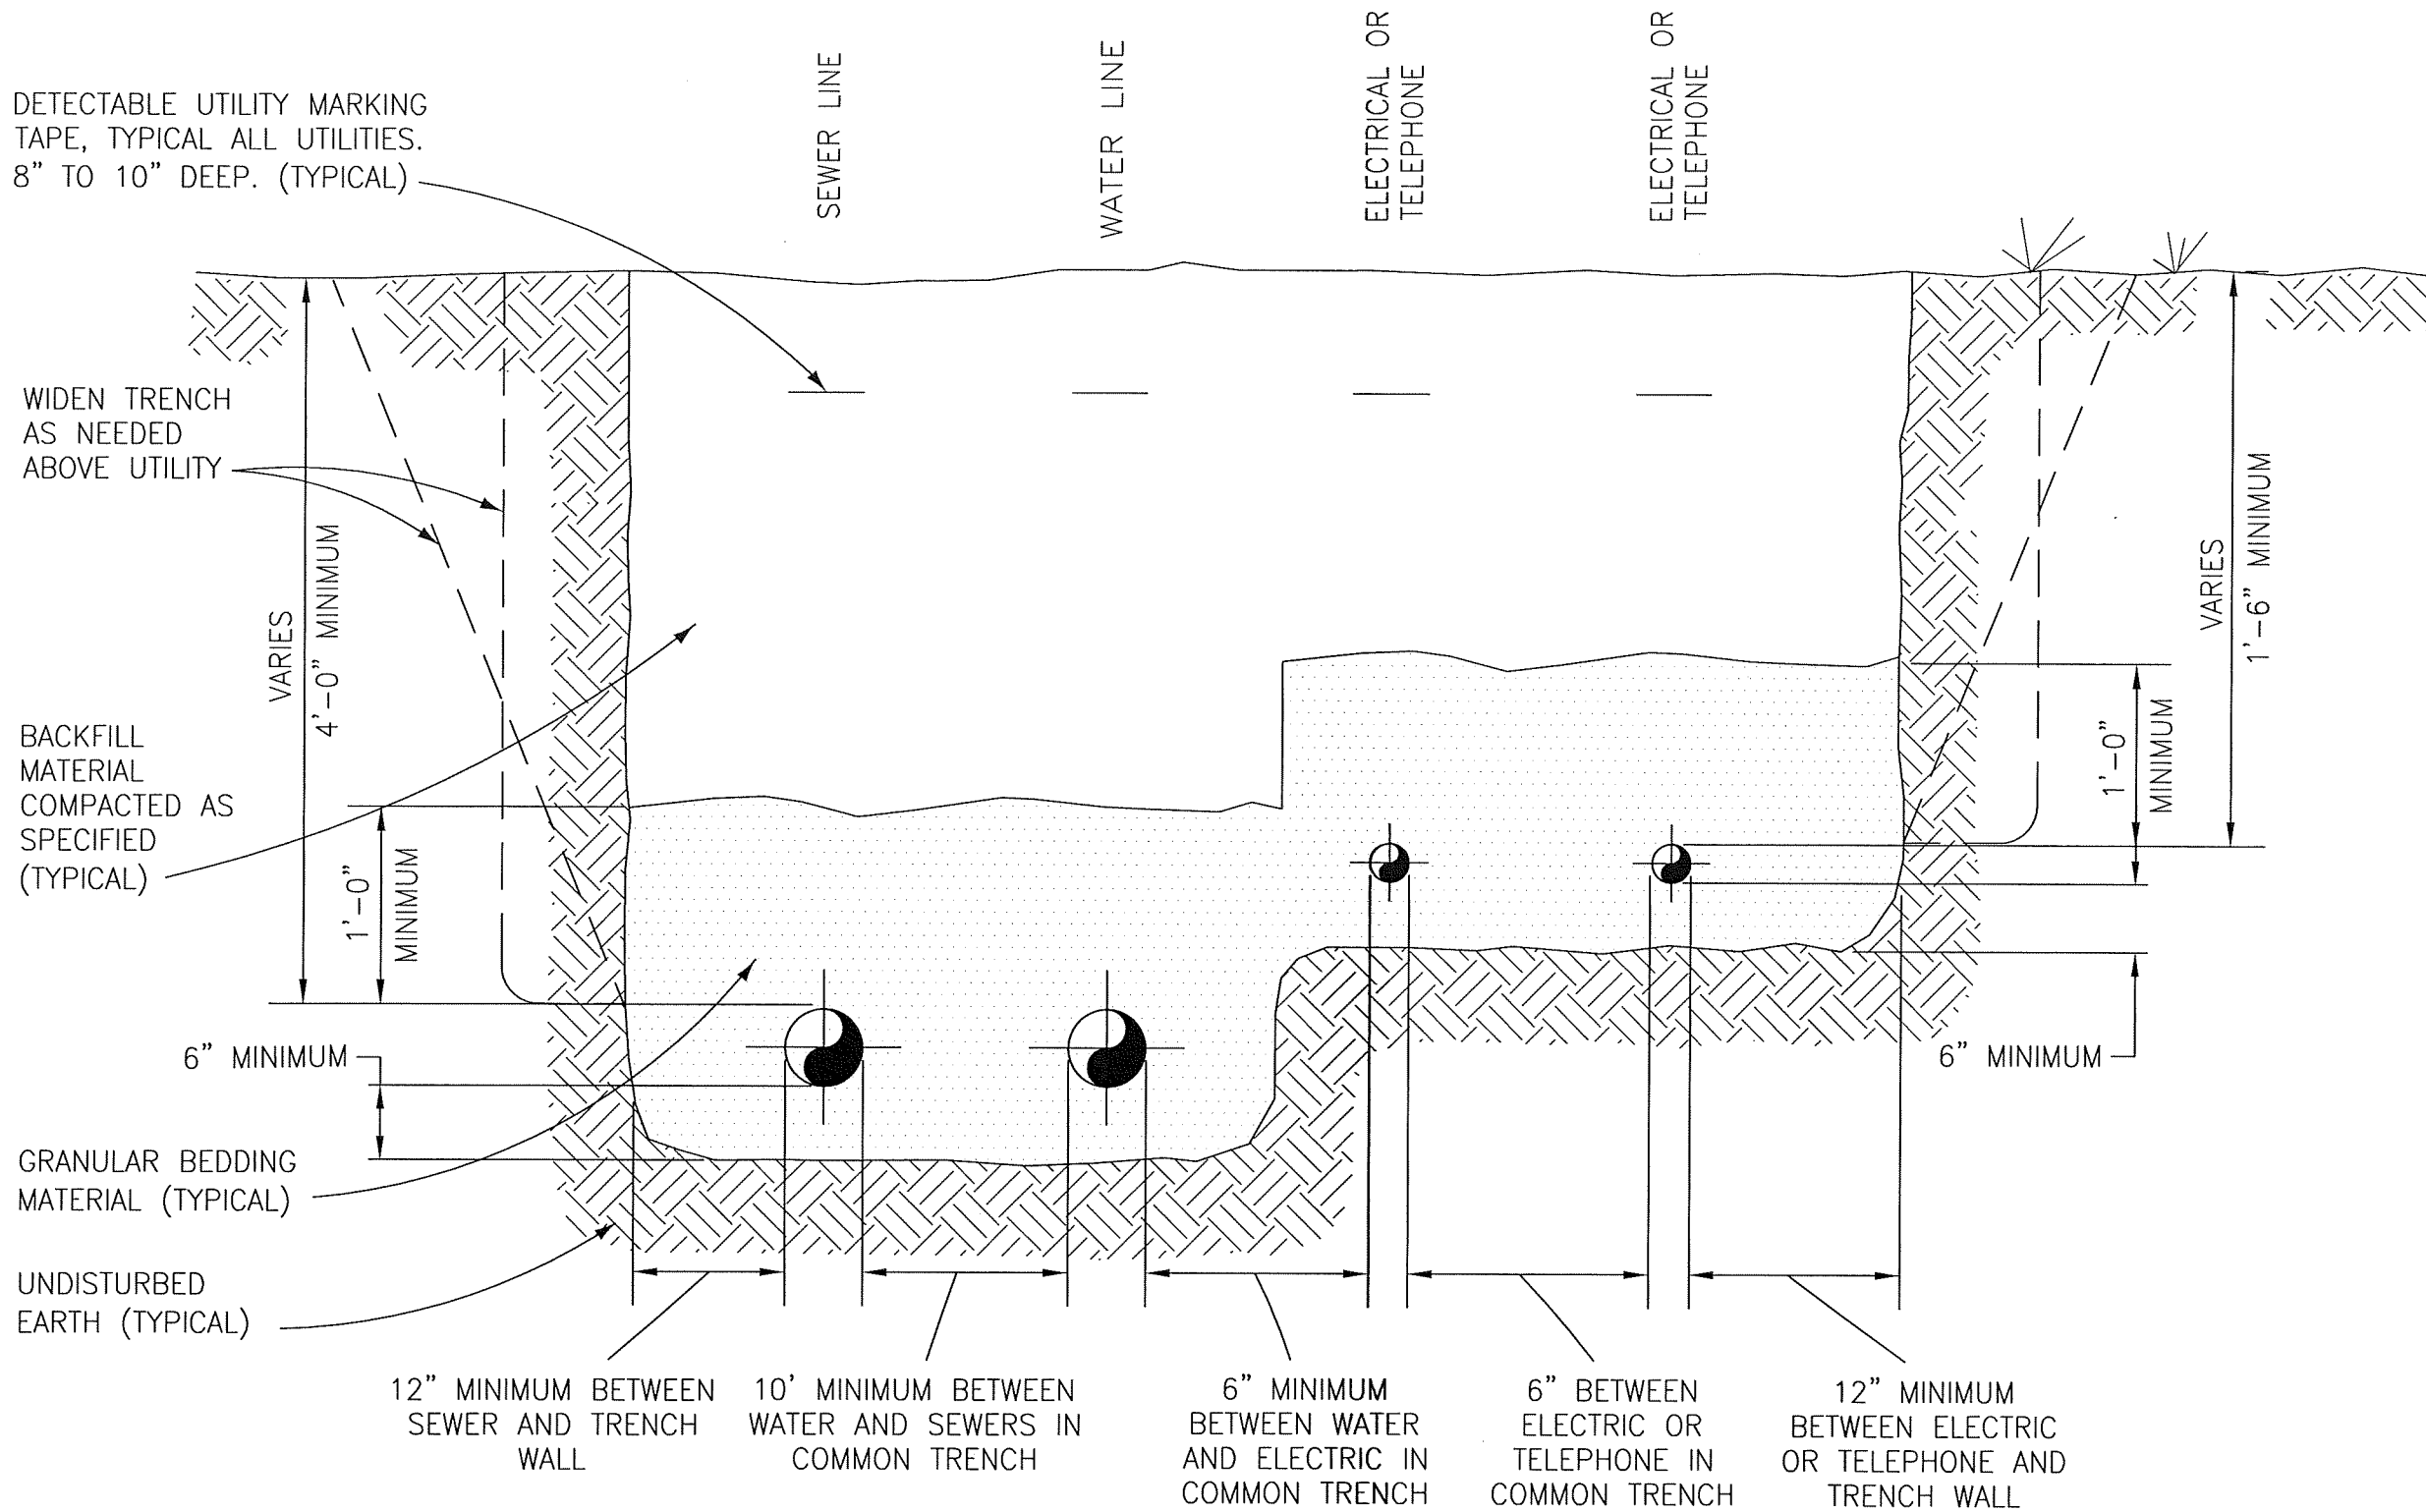

12" MINIMUM BETWEEN SEWER AND TRENCH WALL

10' MINIMUM BETWEEN WATER AND SEWERS IN COMMON TRENCH

6" MINIMUM BETWEEN WATER AND ELECTRIC IN COMMON TRENCH

6" BETWEEN ELECTRIC OR TELEPHONE IN COMMON TRENCH

12" MINIMUM BETWEEN ELECTRIC OR TELEPHONE AND TRENCH WALL

PIPE TRENCH - TYPE B  
NOT TO SCALE

2220B

